

Orest Voznyak, Valentyn Bokhan, Iryna Sukholova, Mariana Kasynets, Hanna Klymenko

IMPROVEMENT OF AIR DISTRIBUTION IN A ROOM WITH SWIRLED AIR JETS

*Department of Heat and Gas Supply and Ventilation,
Lviv Polytechnic National University
valentyn.s.bokhan@lpnu.ua*

© Voznyak O., Bokhan V., Sukholova I., Kasynets M., Klymenko H., 2025

The study examines the velocity decay processes in an isothermal free swirled air jet to improve methods for controlling the aerodynamic characteristics of air flows. The objective is to intensify the velocity decay in the supply air of an isothermal free swirling jet, determine the decay coefficient, and analyze axial velocities by constructing their profiles in cross-sections. To simplify calculations, the velocity decay coefficient “ m ” is introduced. The decay coefficient is determined, an analysis of axial velocity distribution is conducted, and corresponding graphs are constructed. A comparison of experimental data with theoretical models is performed. The features of turbulent structures formed during the decay process are investigated. The possibilities of regulating jet dynamics by modifying input parameters are considered. The obtained results can be used to optimize processes in various technical and industrial applications, including ventilation systems, gas dynamic installations, and energy complexes.

Keywords: air distribution, swirled jet, air velocity, attenuation coefficient, aerodynamics, turbulence.

Introduction

Effective air distribution in indoor spaces is a crucial task for ensuring a comfortable microclimate, energy efficiency, and stable operation of ventilation systems (Almaras et al., 2012). Traditional air supply methods do not always provide uniform flow distribution, which can lead to the formation of stagnant zones or excessive turbulence (Dovhaliuk V. et al., 2018). One way to improve air distribution is through the use of swirling air jets. These jets retain velocity for a longer duration, enhance air mass mixing, and distribute more evenly within the space. Due to these properties, swirling jets can effectively optimize ventilation processes in various indoor environments (Dovhaliuk V., Mileikovskiy V., 2018). Studying the characteristics of swirling jet motion helps to better understand their development patterns and develop methods for controlling aerodynamic properties. This opens up opportunities for improving ventilation, air conditioning, and industrial aerodynamic processes (Kapalo P. et al., 2014).

Materials and Methods

The formation of planar, axisymmetric, and swirling jets with pulsating velocity is influenced by the discharge of supply air from both open and shaded ventilation system openings (Lorin E. et al., 2007).

Various factors affect jet characteristics, particularly the surfaces they interact with. Jets without obstacles are considered free, while those influenced by surfaces are constrained (Kapalo, P. et al., 2017). A jet is classified as isothermal if its outlet temperature matches the indoor air temperature, whereas it is non-isothermal if the temperatures differ (Kapalo P., et al., 2014).

When the Reynolds number (Re) is below 2300, the flow is laminar, while a value exceeding 10,000 indicates turbulence (Andersson H., et al., 2018). The jet core represents a region of the flow with constant velocity and temperature. The jet's pole O is located at a specific distance from the nozzle exit along its axis. By drawing lines from this point through the nozzle exit boundaries, the external jet boundaries can be determined (Bin Z., et al., 2003).

Fig. 1 showed in the primary formation region of the jet, a gradual decrease in axial velocity occurs V_x (in non-isothermal jets), along with a decline in excess temperature Δt_x , which is defined as the difference between the air temperature in the jet t_x and that in the room t_{in} : $\Delta t_x = t_x - t_{in}$ (Gumen O. et al., 2019).

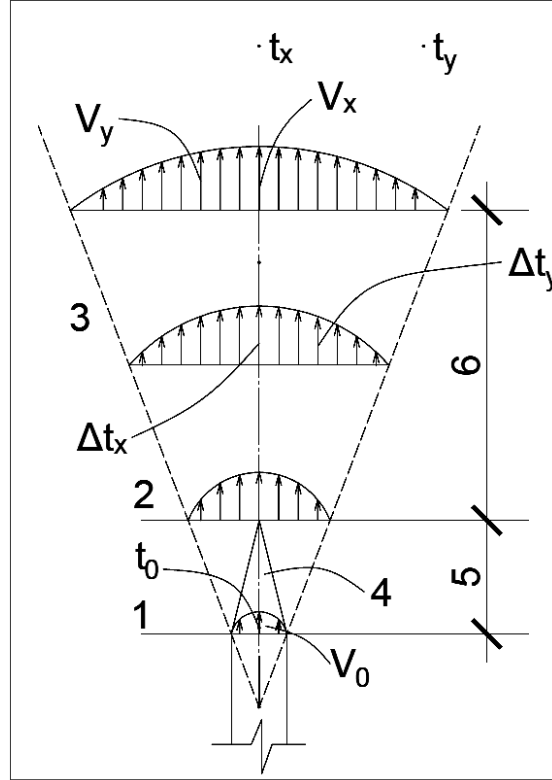


Fig. 1. Diagram of Free Air Jet Development: 1 – Initial cross-section; 2 – Transitional cross-section; 3 – Jet boundaries; 4 – Jet core; 5 – l_0 (initial area); 6 – l_x (main area)

Depending on the Ar_o parameter, supply jets are classified as weakly non-isothermal (barely affected by gravitational forces) and non-isothermal (significantly influenced by gravitational forces) (Gumen, O. et al., 2017).

The excess temperature $\Delta t_x = t_x - t_{in}$ (for horizontally directed weakly non-isothermal air jets) can be calculated using equation (1):

$$\Delta t_x = \frac{N}{x}, \quad (1)$$

where x is the current longitudinal coordinate (Janbakhsh, S., Moshfegh B., 2014); N is the thermal characteristic:

$$N = \frac{0,54}{\text{tg}\alpha} \sqrt{\frac{T_e}{T_o}} \cdot \frac{1}{\sqrt[4]{\xi}} \cdot \Delta t_o \cdot \sqrt{F_o}, \quad (2)$$

where α is the jet expansion angle, $\alpha = 12^\circ 25'$, with $\text{tg}\alpha = 0.22$; ξ is the local resistance coefficient, $\xi = 1$; T_x is the absolute temperature at the nozzle outlet (Rumsey C. L., Spalart P. R., 2009).

To simplify calculations, the temperature decay coefficient n is introduced:

$$n = \frac{0,54}{\text{tg}\alpha} \sqrt{\frac{T_e}{T_o}} \cdot \frac{1}{\sqrt[4]{\xi}}. \quad (3)$$

The axial excess temperature Δt_x is given by (Srebric J., Chen, Q., 2002):

$$\Delta t_x = n \cdot \Delta t_o \cdot \frac{\sqrt{F_o}}{x}. \quad (4)$$

At any cross-section “x”, at a distance “y”, the excess temperature $\Delta t_y = t_y - t_v$ is calculated using Taylor’s formula (5):

$$\Delta t_y = \Delta t_x \cdot \exp\left(-0,7\sigma_T \bar{y}^2\right), \quad (5)$$

where σ_T is the turbulent Prandtl number, $\sigma_T = 0.65 \div 0.7$ for compact jets; $\bar{y}$ is the current transverse coordinate, $\bar{y} = y/cx$, with $c = 0.28$ as an experimental constant.

It is rational to use relative indicators of excess temperatures, both axial $\bar{\Delta t}_x = \Delta t_x / \Delta t_o$ and at any cross-section $\bar{\Delta t}_y = \Delta t_y / \Delta t_x$ (Voznyak O. et al., 2019).

The objective is to intensify the velocity decay in the supply air of an isothermal free swirling jet, determine the decay coefficient, and analyze axial velocities by constructing their profiles in cross-sections.

Result and discussion

To determine the axial velocity V_x in isothermal air jets, equation (6) is used:

$$V_x = \frac{M}{x}, \quad (6)$$

where x is the current longitudinal coordinate; M is the dynamic characteristic calculated as:

$$M = \frac{0,66}{\operatorname{tg} \alpha} \sqrt{\frac{T_o}{T_{in}}} \cdot \sqrt[4]{\xi} \cdot V_o \cdot \sqrt{F_o}, \quad (7)$$

where α is the jet expansion angle, $\alpha = 12^\circ 25'$, with $\operatorname{tg} \alpha = 0.22$; ξ is the local resistance coefficient, $\xi = 1$; T_o , T_{in} are the absolute temperatures at the nozzle outlet and in the room, respectively; V_o is the initial velocity, m/s; F_o is the area of the supply nozzle, m^2 .

To simplify calculations, the velocity decay coefficient m is introduced:

$$m = \frac{0,66}{\operatorname{tg} \alpha} \sqrt{\frac{T_{in}}{T_o}} \cdot \sqrt[4]{\xi}. \quad (8)$$

The axial velocity V_x is determined as:

$$V_x = m \cdot V_o \cdot \frac{\sqrt{F_o}}{x}. \quad (9)$$

At any cross-section “x”, at a distance “y” from the axis, the velocity V_y is calculated using Schlichting’s formula:

$$V_y = V_x \left[1 - \left(\frac{y}{y_b} \right)^{1,5} \right]^2. \quad (10)$$

For both axial $\bar{V}_x = V_x / V_o$ and cross-sectional velocity values $\bar{V}_y = V_y / V_y$, it is rational to use relative velocity indicators. In this case:

$$\bar{V}_x = \frac{0,48}{\frac{ax}{de} + 0,145}, \quad (11)$$

where $a = 0.078$; d_e is the equivalent nozzle diameter.

The Archimedes number Ar_o describes the ratio between gravitational and inertial forces:

$$Ar_o = \frac{g \sqrt{F_o} \cdot \Delta t_o}{V_o^2 \cdot T_{in}}, \quad (12)$$

where $g = 9.81 \text{ m/s}^2$; F_o is the nozzle area, m^2 ; Δt_o is the initial excess temperature, $\Delta t_y = t_y - t_v$, K; T_v is the absolute air temperature in the room, K; V_o is the initial velocity, m/s .

For the calculations, a testo-405 thermal electrical anemometer was used. The initial velocity V_o was measured. By selecting x_i values in the range $0.7 \div 2.2$, relative velocities were computed using formula (11) for the respective jets, and graphs were constructed $\bar{V}_x = f(\bar{x})$, where $\bar{x} = x / \sqrt{F_o}$.

Fig. 2 showed a satisfactory agreement of the obtained experimental results with theoretical data. $\bar{V}_x = f(x)$: where 1 – experimental points; 2 – graphical dependency.

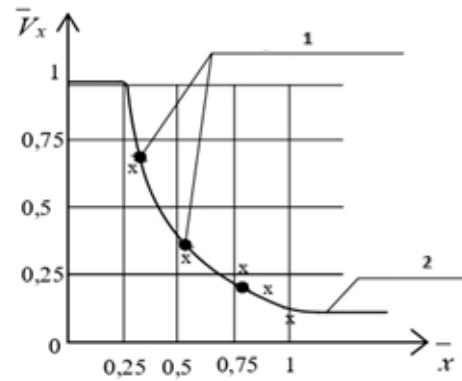


Fig. 2. Dependence of relative axial velocity on relative longitudinal coordinate

Conclusions

1. The study of velocity decay in an isothermal free swirled air jet provided valuable data for improving methods of controlling the aerodynamic characteristics of the air flows.
2. The distribution of axial velocities was analyzed.
3. A comparison of experimental results with theoretical models confirmed their consistency, indicating the reliability of the obtained data and their potential application in technical and industrial processes.

References

- Allmaras, S. R., Johnson, F. T., & Spalart, P. R. (2012). *Modifications and clarifications for the implementation of the spalart-allmaras turbulence model ICCFD7-1902*. 7th International Conference on Computational Fluid Dynamics, Hawaii. https://www.iccfd.org/iccfd7/assets/pdf/papers/ICCFD7-1902_paper.pdf.
- Dovhaliuk, V. et al. (2018). Simplified analysis of turbulence intensity in curvilinear wall jets. *FME Transactions*, 46, 177–182. doi.org/10.5937/fmet.1802177D.
- Dovhaliuk, V., & Mileikovskiy, V. (2018). New approach for refined efficiency estimation of air exchange organization. *International Journal of Engineering and Technology (UAE)*, 7(3.2), 591–596. doi:10.14419/ijet.v7i3.2.14596.
- Kapalo, P., Sedláková, A., Košicanová, D., Voznyak, O., Lojkovics, J., & Siroczki P. (2014). *Effect of ventilation on indoor environmental quality in buildings. The 9th International Conference “Environmental Engineering”*, Vilnius, Lithuania Selected Papers, eISSN 2029-7092/eISBN 978-609-457-640-9.
- Lorin, E., Benhajali, A., & Soulaimani, A. (2007). Positivity Preserving Finite Element-Finite Volume Solver for The Spalart-Allmaras Turbulence Model. *Computer Methods in Applied Mechanics and Engineering*, Vol. 196, No. 17–20, 2097–2116. DOI: 10.1016/j.cma.2006.10.009.
- Kapalo, P., Vilceková, S., Domnita, F., Bacotiu, C., & Voznyak, O. (2017). *Determining the Ventilation Rate inside an Apartment House on the Basis of Measured Carbon Dioxide Concentrations. The 10-th International Conference “Environmental Engineering”*, Vilnius, Lithuania, Selected Papers, 30–35. DOI: 10.3846/enviro.2017.262
- Kapalo, P., Vilcekova, S., & Voznyak, O. (2014). Using experimental measurements the concentrations of carbon dioxide for determining the intensity of ventilation in the rooms. *Chemical Engineering Transactions*, 39, 1789–1794. DOI: 10.3303/CET1439299
- Andersson, H., Cehlin, M., & Moshfegh, B. (2018). Experimental and numerical investigations of a new ventilation supply device based on confluent jets. *Building and Environment*, Vol. 137, 18–33. DOI: 10.1016/j.buildenv.2018.03.038
- Bin, Z., Xianting, L., Qisen, Y. Zh. (2003). A simplified system for indoor airflow simulation. *Building and Environment*, Vol. 38, 543–552. DOI: 10.1016/S0360-1323(02)00182-8

Gumen, O., Dovhaliuk, V., & Mileikovskiy, V. (2019). Geometric representation of turbulent macrostructure in 3D jets. *ICGG 2018, Proceedings of the 18-th International Conference on Geometry and Graphics*, 739–745. DOI: 10.1007/978-3-319-95588-9_61.

Gumen, O. et al. (2017). Geometric analysis of turbulent macrostructure in jets laid on flat surfaces for turbulence intensity calculation. *FME Transaction*, 45, 236–242. DOI: 10.5937/fmet1702236G.

Janbakhsh, S., & Moshfegh B. (2014). Experimental investigation of a ventilation system based on wall confluent jets. *Building and Environment*, Vol. 80, 18–31. DOI: 10.1016/j.buildenv.2014.05.011

Rumsey, C. L., & Spalart P. R. (2009). Turbulence Model Behavior in Low Reynolds Number Regions of Aerodynamic Flowfields. *ALAA Journal*, Vol. 47, No 4, 982–993. DOI: 10.2514/1.39947

Srebric, J., & Chen, Q. (2002). Simplified Numerical Models for Complex Air Supply Diffusers. *HVAC&R Research*, 8(3), 277–294. DOI: 10.1080/10789669.2002.10391442

Voznyak, O., Korbut V., Davydenko B., & Sukholova I. (2019). Air distribution efficiency in a room by a two-flow device. *Springer, Proceedings of CEE 2019. Advances in Resource-saving Technologies and Materials in Civil and Environmental Engineering*, Vol. 47, 526–533. DOI: 10.1007/978-3-030-27011-7_67

О. Т. Возняк, В. С. Бохан, І. Є. Сухолова, М. Є. Касинець, Г. М. Клименко

Національний університет “Львівська політехніка”,
кафедра теплогазопостачання і вентиляції

УДОСКОНАЛЕННЯ ПОВІТРОРІЗПОДІЛУ У ПРИМІЩЕННІ ЗАКРУЧЕНИМИ ПОВІТРЯНИМИ СТРУМЕНЯМИ

© Возняк О. Т., Бохан В. С., Сухолова І. Є., Касинець М. Є., Клименко Г. М., 2025

У роботі досліджено процеси загасання швидкості в ізотермічному вільному закрученому струмені з метою удосконалення методів керування аеродинамічними характеристиками потоків. Метою є інтенсифікація загасання швидкості у поданому повітрі ізотермічного вільного закрученого струменя, визначення коефіцієнта загасання та аналіз осьових швидкостей за допомогою побудови їх профілів у поперечних перерізах. Для спрощення розрахунків введено коефіцієнт загасання швидкості “ m ”. Визначено коефіцієнт загасання, проаналізовано розподіл осьових швидкостей, а також побудовано їх графіки. Виконано аналіз розподілу осьових швидкостей повітря. Запропоновано раціональний метод визначення відносного показника швидкості. Для описання взаємозв’язку між гравітаційними та інерційними силами вибрано критерій Архімеда, а для описання профілю швидкості запропоновано математичну модель Шліхтінга. Отримані результати подано у вигляді графічних залежностей, а також аналітичних рівнянь із введенням коригувальних коефіцієнтів. Здійснено порівняння експериментальних даних із теоретичними моделями. Досліджено особливості турбулентних структур, що формуються під час загасання. Розглянуто можливості регулювання динаміки струменя зміною вхідних параметрів. Порівняння експериментальних результатів із теоретичними моделями підтвердило їхню узгодженість, що свідчить про достовірність отриманих даних і їхній потенціал для застосування у технічних та промислових процесах. Результати показали задовільну відповідність експериментальних даних теоретичним розрахункам. Їх можна використовувати для оптимізації процесів у різних технічних і промислових сферах, зокрема у вентиляційних системах, газодинамічних установках та енергетичних комплексах.

Ключові слова: розподіл повітря, закручений струмінь, швидкість повітря, коефіцієнт загасання, аеродинаміка, турбулентність.